



OPTION A

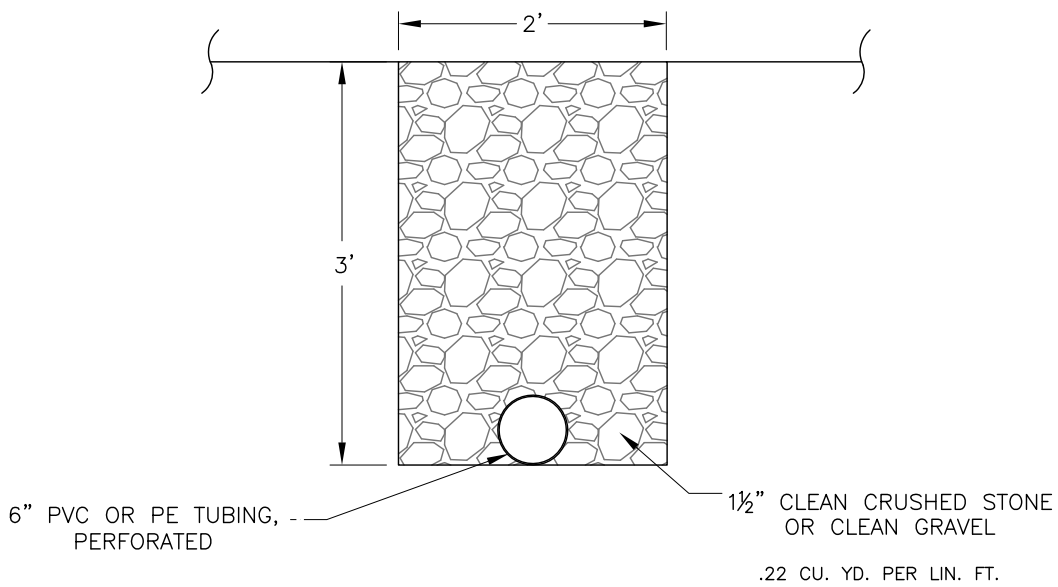

OPTION B

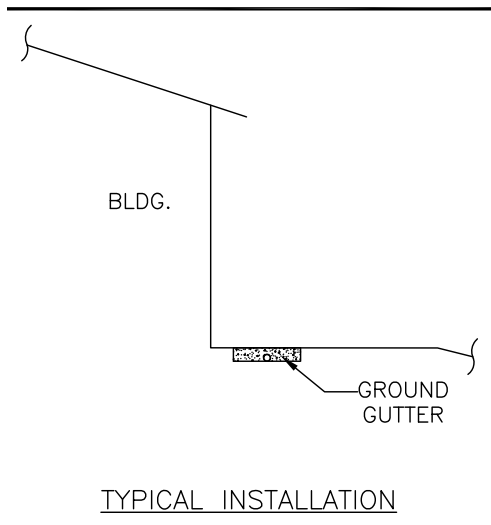

NOTES:

1. ALL PIPE SHALL MEET WISCONSIN CONSTRUCTION SPECIFICATION 15 OR 44.
2. PLACE CENTER OF TRENCH BELOW ROOF DRIP LINE.
3. SIZE PIPE FOR ANY ADDITIONAL SURFACE WATER NOT EXCLUDED FROM THE TRENCH.
4. CONSIDER FILTER CLOTH OR PLASTIC AS A WEED/SOIL BARRIER AT THE BOTTOM OF THE TRENCH.

QUANTITIES*	
1 1/2" CLEAN CRUSHED STONE OR GRAVEL	CU. YD.
6" PVC OR PE TUBING, PERFORATED	LIN. FT.

* ESTIMATED TO THE NEAT LINES AND GRADES